

GROUNDING NOTES

1. THE SUBCONTRACTOR SHALL REVIEW AND INSPECT THE EXISTING FACILITY GROUNDING SYSTEM AND LIGHTNING PROTECTION SYSTEM (AS DESIGNED AND INSTALLED) FOR STRICT COMPLIANCE WITH THE NEC (AS ADOPTED BY THE AHJ), THE SITE-SPECIFIC (UL, LPI, OR NFPA) LIGHTING PROTECTION CODE, AND GENERAL COMPLIANCE WITH TELCORDIA AND TIA GROUNDING STANDARDS. THE SUBCONTRACTOR SHALL REPORT ANY VIOLATIONS OR ADVERSE FINDINGS TO THE CONTRACTOR FOR RESOLUTION.
2. ALL GROUND ELECTRODE SYSTEMS (INCLUDING TELECOMMUNICATION, RADIO, LIGHTNING PROTECTION, AND AC POWER GES'S) SHALL BE BONDED TOGETHER, AT OR BELOW GRADE, BY TWO OR MORE COPPER BONDING CONDUCTORS IN ACCORDANCE WITH THE NEC.
3. THE SUBCONTRACTOR SHALL PERFORM IEEE FALL-OF-POTENTIAL RESISTANCE TO EARTH TESTING (PER IEEE 1100 AND 81) FOR NEW GROUND ELECTRODE SYSTEMS. THE SUBCONTRACTOR SHALL FURNISH AND INSTALL SUPPLEMENTAL GROUND ELECTRODES AS NEEDED TO ACHIEVE A TEST RESULT OF 5 OHMS OR LESS.
4. METAL RACEWAY SHALL NOT BE USED AS THE NEC REQUIRED EQUIPMENT GROUND CONDUCTOR. STRANDED COPPER CONDUCTORS WITH GREEN INSULATION, SIZED IN ACCORDANCE WITH THE NEC, SHALL BE FURNISHED AND INSTALLED WITH THE POWER CIRCUITS TO BTS EQUIPMENT.
5. EACH BTS CABINET FRAME SHALL BE DIRECTLY CONNECTED TO THE MASTER GROUND BAR WITH GREEN INSULATED SUPPLEMENTAL EQUIPMENT GROUND WIRES, 6 AWG STRANDED COPPER OR LARGER FOR INDOOR BTS 2 AWG STRANDED COPPER FOR OUTDOOR BTS.
6. EXOTHERMIC WELDS SHALL BE USED FOR ALL GROUNDING CONNECTIONS BELOW GRADE.
7. APPROVED ANTIOXIDANT COATINGS (I.E., CONDUCTIVE GEL OR PASTE) SHALL BE USED ON ALL COMPRESSION AND BOLTED GROUND CONNECTIONS.
8. ICE BRIDGE BONDING CONDUCTORS SHALL BE EXOTHERMICALLY BONDED OR BOLTED TO THE BRIDGE AND THE TOWER GROUND BAR.
9. ALUMINUM CONDUCTOR OR COPPER CLAD STEEL CONDUCTOR SHALL NOT BE USED FOR GROUNDING CONNECTIONS.
10. MISCELLANEOUS ELECTRICAL AND NON-ELECTRICAL METAL BOXES, FRAMES AND SUPPORTS SHALL BE BONDED TO THE GROUND RING, IN ACCORDANCE WITH THE NEC.
11. METAL CONDUIT SHALL BE MADE ELECTRICALLY CONTINUOUS WITH LISTED BONDING FITTINGS OR BY BONDING ACROSS THE DISCONTINUITY WITH 6 AWS COPPER WIRE UL APPROVED GROUNDING TYPE CONDUIT CLAMPS.
12. ALL NEW STRUCTURES WITH A FOUNDATION AND/OR FOOTING HAVING 20 FT. OR MORE 1/2" OR GREATER ELECTRICALLY CONDUCTIVE REINFORCING STEEL MUST HAVE IT BONDED TO THE GROUND RING USING AN EXOTHERMIC WELD CONNECTION USING #2 AWG SOLID TINNED COPPER GROUND WIRE, PER NEC 250.50

GENERAL NOTES

1. FOR THE PURPOSE OF CONSTRUCTION DRAWING, THE FOLLOWING DEFINITIONS SHALL APPLY:
 CONTRACTOR – SAI
 SUBCONTRACTOR – GENERAL CONTRACTOR (CONSTRUCTION)
 OWNER – AT&T MOBILITY
2. PRIOR TO THE SUBMISSION OF BIDS, THE BIDDING SUBCONTRACTOR SHALL VISIT THE CELL SITE TO FAMILIARIZE WITH THE EXISTING CONDITIONS AND TO CONFIRM THAT THE WORK CAN BE ACCOMPLISHED AS SHOWN ON THE CONSTRUCTION DRAWINGS. ANY DISCREPANCY FOUND SHALL BE BROUGHT TO THE ATTENTION OF CONTRACTOR.
3. ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. SUBCONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF THE WORK. ALL WORK CARRIED OUT SHALL COMPLY WITH ALL APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES AND APPLICABLE REGULATIONS.
4. DRAWINGS PROVIDED HERE ARE NOT TO BE SCALED AND ARE INTENDED TO SHOW OUTLINE ONLY.
5. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
6. "KITTING LIST" SUPPLIED WITH THE BID PACKAGE IDENTIFIES ITEMS THAT WILL BE SUPPLIED BY CONTRACTOR. ITEMS NOT INCLUDED IN THE BILL OF MATERIALS AND KITTING LIST SHALL BE SUPPLIED BY THE SUBCONTRACTOR.
7. THE SUBCONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.
8. IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE SUBCONTRACTOR SHALL PROPOSE AN ALTERNATIVE INSTALLATION SPACE FOR APPROVAL BY THE CONTRACTOR.
9. SUBCONTRACTOR SHALL DETERMINE ACTUAL ROUTING OF CONDUIT, POWER AND T1 CABLES, GROUNDING CABLES AS SHOWN ON THE POWER, GROUNDING AND TELCO PLAN DRAWING. SUBCONTRACTOR SHALL UTILIZE EXISTING TRAYS AND/OR SHALL ADD NEW TRAYS AS NECESSARY. SUBCONTRACTOR SHALL CONFIRM THE ACTUAL ROUTING WITH THE CONTRACTOR.
10. THE SUBCONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES. ANY DAMAGED PART SHALL BE REPAIRED AT SUBCONTRACTOR'S EXPENSE TO THE SATISFACTION OF OWNER.
11. SUBCONTRACTOR SHALL LEGALLY AND PROPERLY DISPOSE OF ALL SCRAP MATERIALS SUCH AS COAXIAL CABLES AND OTHER ITEMS REMOVED FROM THE EXISTING FACILITY. ANTENNAS REMOVED SHALL BE RETURNED TO THE OWNER'S DESIGNATED LOCATION.
12. SUBCONTRACTOR SHALL LEAVE PREMISES IN CLEAN CONDITION.
13. ALL CONCRETE REPAIR WORK SHALL BE DONE IN ACCORDANCE WITH AMERICAN CONCRETE INSTITUTE (ACI) 301.
14. ANY NEW CONCRETE NEEDED FOR THE CONSTRUCTION SHALL BE AIR-ENTRAINED AND SHALL HAVE 4000 PSI STRENGTH AT 28 DAYS. ALL CONCRETE WORK SHALL BE DONE IN ACCORDANCE WITH ACI 318 CODE REQUIREMENTS.

15. ALL STRUCTURAL STEEL WORK SHALL BE DETAILED, FABRICATED AND ERECTED IN ACCORDANCE WITH AISC SPECIFICATIONS. ALL STRUCTURAL STEEL SHALL BE ASTM A36 (Fy = 36 ksi) UNLESS OTHERWISE NOTED. PIPES SHALL BE ASTM A53 TYPE E (Fy = 36 ksi). ALL STEEL EXPOSED TO WEATHER SHALL BE HOT DIPPED GALVANIZED. TOUCHUP ALL SCRATCHES AND OTHER MARKS IN THE FIELD AFTER STEEL IS ERECTED USING A COMPATIBLE ZINC RICH PAINT.

16. CONSTRUCTION SHALL COMPLY WITH SPECIFICATIONS AND "GENERAL CONSTRUCTION SERVICES FOR CONSTRUCTION OF AT&T MOBILITY SITES."

17. SUBCONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS MUST BE VERIFIED. SUBCONTRACTOR SHALL NOTIFY THE CONTRACTOR OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.

18. THE EXISTING CELL SITE IS IN FULL COMMERCIAL OPERATION. ANY CONSTRUCTION WORK BY SUBCONTRACTOR SHALL NOT DISRUPT THE EXISTING NORMAL OPERATION. ANY WORK ON EXISTING EQUIPMENT MUST BE COORDINATED WITH CONTRACTOR. ALSO, WORK SHOULD BE SCHEDULED FOR AN APPROPRIATE MAINTENANCE WINDOW USUALLY IN LOW TRAFFIC PERIODS AFTER MIDNIGHT.

19. SINCE THE CELL SITE IS ACTIVE, ALL SAFETY PRECAUTIONS MUST BE TAKEN WHEN WORKING AROUND HIGH LEVELS OF ELECTROMAGNETIC RADIATION. EQUIPMENT SHOULD BE SHUTDOWN PRIOR TO PERFORMING ANY WORK THAT COULD EXPOSE THE WORKERS TO DANGER. PERSONAL RF EXPOSURE MONITORS ARE ADVISED TO BE WORN TO ALERT OF ANY DANGEROUS EXPOSURE LEVELS.

20. APPLICABLE BUILDING CODES:
 SUBCONTRACTOR'S WORK SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE, AND LOCAL CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION (AHJ) FOR THE LOCATION. THE EDITION OF THE AHJ ADOPTED CODES AND STANDARDS IN EFFECT ON THE DATE OF CONTRACT AWARD SHALL GOVERN THE DESIGN.
 BUILDING CODE: MA STATE BUILDING CODE 780 CMR 8TH EDITION
 ELECTRICAL CODE: REFER TO ELECTRICAL DRAWINGS
 LIGHTENING CODE: REFER TO ELECTRICAL DRAWINGS

SUBCONTRACTOR'S WORK SHALL COMPLY WITH THE LATEST EDITION OF THE FOLLOWING STANDARDS:

AMERICAN CONCRETE INSTITUTE (ACI) 318; BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE;

AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC)

MANUAL OF STEEL CONSTRUCTION, ASD, FOURTEENTH EDITION;


TELECOMMUNICATIONS INDUSTRY ASSOCIATION (TIA) 222-G, STRUCTURAL STANDARDS FOR STEEL

ANTENNA TOWER AND ANTENNA SUPPORTING STRUCTURES; REFER TO ELECTRICAL DRAWINGS FOR SPECIFIC ELECTRICAL STANDARDS.

FOR ANY CONFLICTS BETWEEN SECTIONS OF LISTED CODES AND STANDARDS REGARDING MATERIAL, METHODS OF CONSTRUCTION, OR OTHER REQUIREMENTS, THE MOST RESTRICTIVE REQUIREMENT SHALL GOVERN. WHERE THERE IS CONFLICT BETWEEN A GENERAL REQUIREMENT AND A SPECIFIC REQUIREMENT, THE SPECIFIC REQUIREMENT SHALL GOVERN.

ABBREVIATIONS

AGL	ABOVE GRADE LEVEL	G.C.	GENERAL CONTRACTOR	RF	RADIO FREQUENCY
AWG	AMERICAN WIRE GAUGE	MGB	MASTER GROUND BUS		
BCW	BARE COPPER WIRE	MIN	MINIMUM	TBD	TO BE DETERMINED
BTS	BASE TRANSCEIVER STATION	PROPOSED - NEW		TBR	TO BE REMOVED
EXISTING	EXISTING	N.T.S. OF MANUFACTURER	NOT TO SCALE	TBRR	TO BE REMOVED AND REPLACED
EG	EQUIPMENT GROUND	REF	REFERENCE	TYP	TYPICAL
EGR	EQUIPMENT GROUND RING	REQ	REQUIRED		

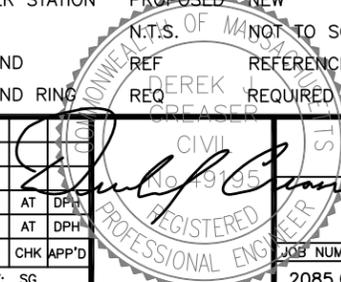

Hudson Design Group
 1600 OSGOOD STREET
 BUILDING 20 NORTH, SUITE 3090
 N. ANDOVER, MA 01845
 TEL: (978) 557-5553
 FAX: (978) 336-5586

SAI
 27 NORTHWESTERN DR.
 SALEM, NH 03079

SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
 252 MEDFORD STREET
 SOMERVILLE, MA 02143
 MIDDLESEX COUNTY

at&t
 550 COCHITUATE ROAD
 FRAMINGHAM, MA 01701




NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH
SCALE: AS SHOWN		DESIGNED BY: AT	DRAWN BY: SG		

AT&T	
GENERAL NOTES (LTE-3C)	
JOB NUMBER	DRAWING NUMBER
2085.00	GN-1
	1



NOTE:
REFER TO THE FINAL RF DATA SHEET FOR FINAL ANTENNA SETTINGS.


NOTE:
AN ANALYSIS FOR THE CAPACITY OF THE EXISTING STRUCTURES TO SUPPORT THE PROPOSED EQUIPMENT SHALL BE DETERMINED PRIOR TO CONSTRUCTION.

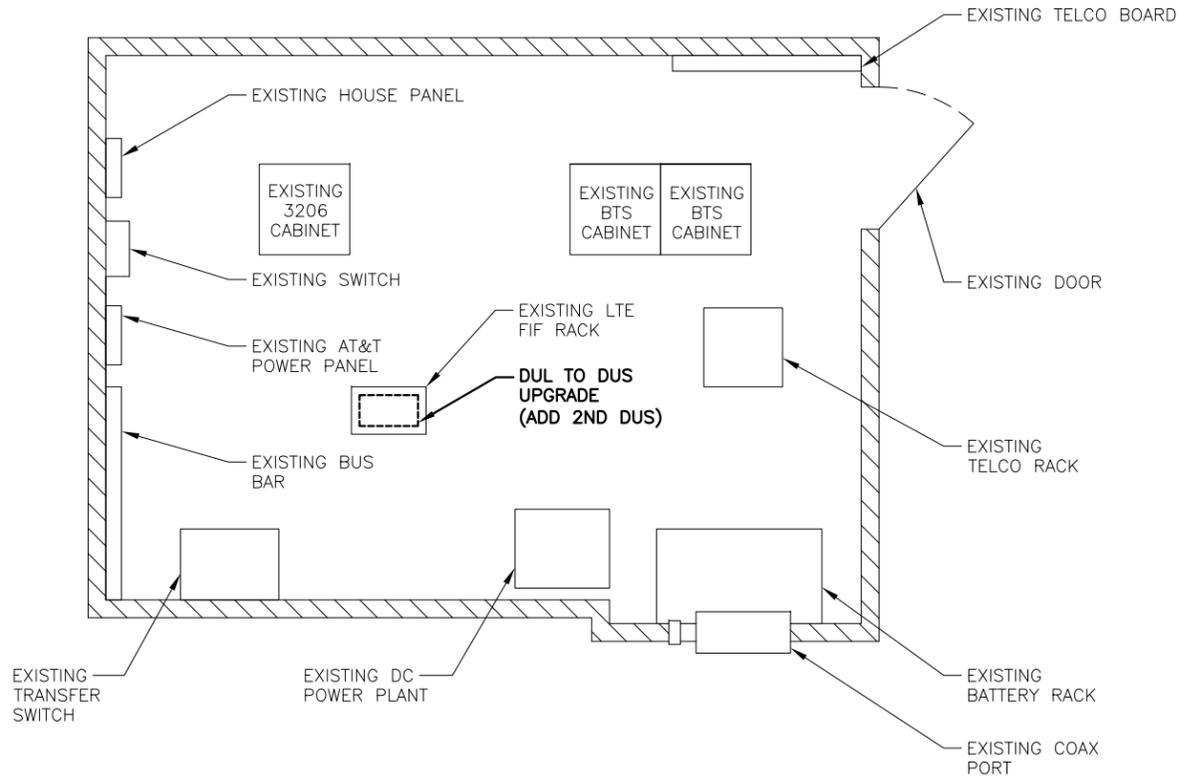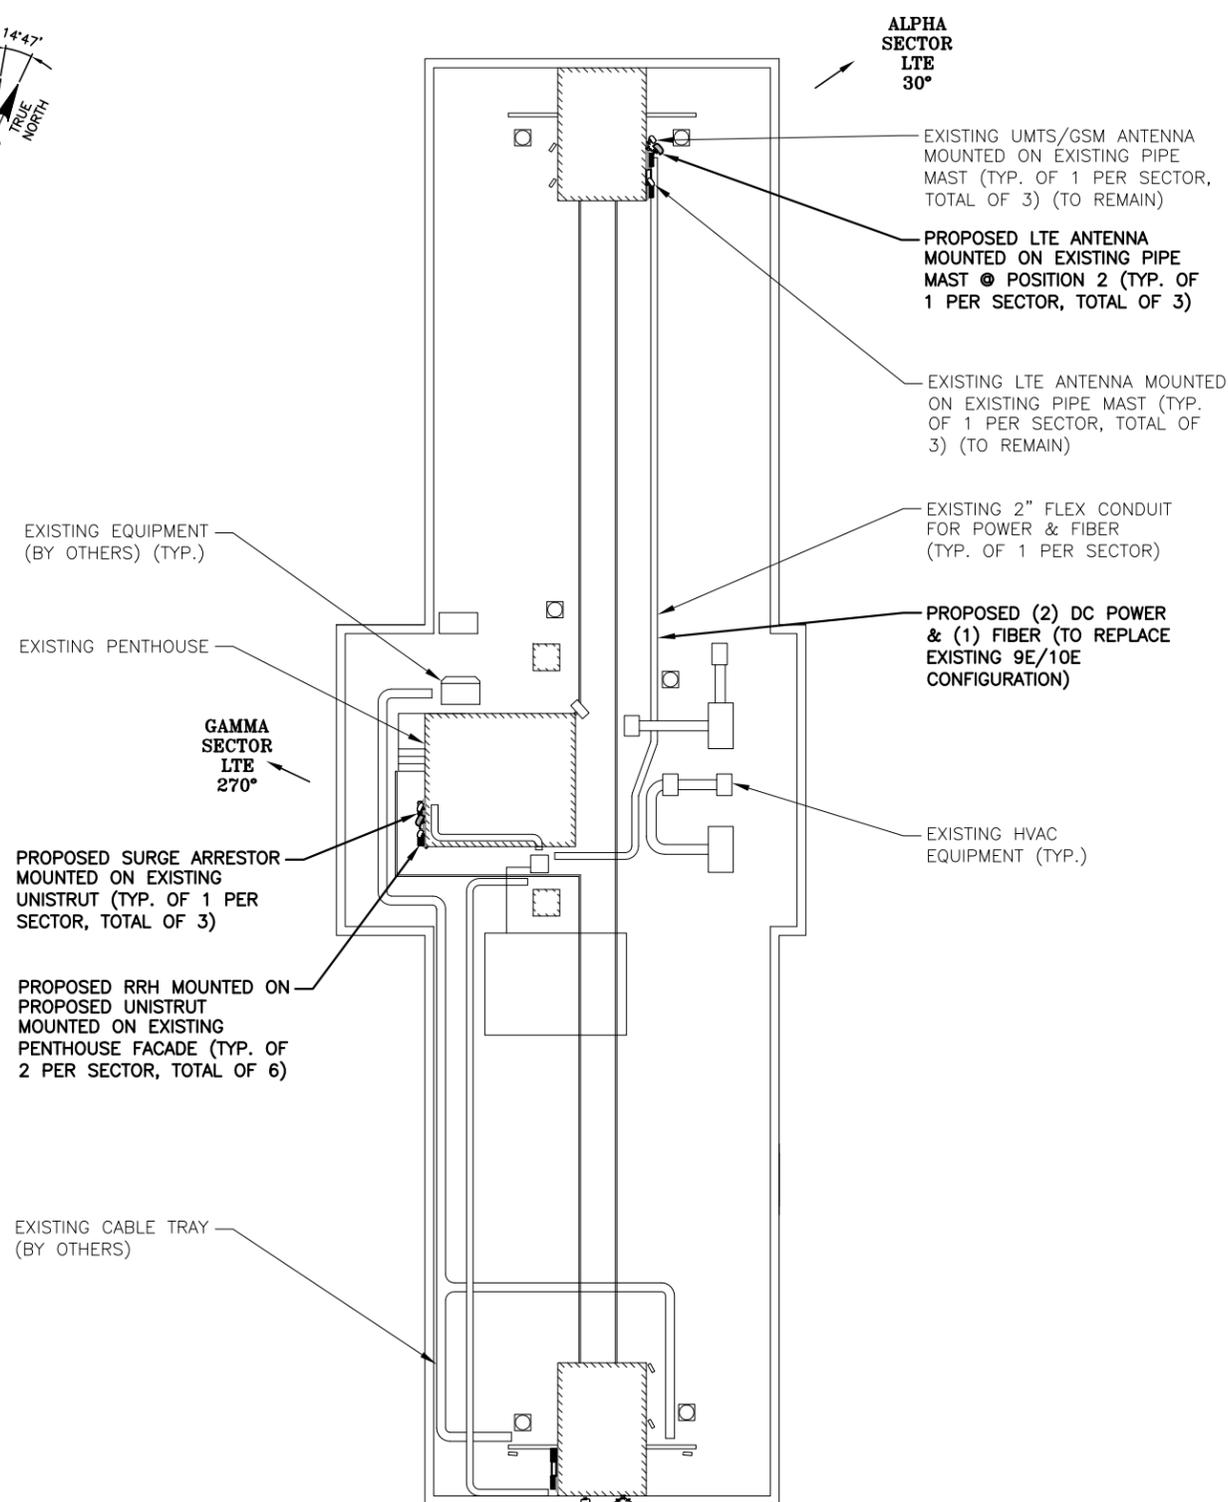

NOTE:
NEW HARDWARE R503/XMU03 WILL BE PLACED INSIDE 6601 CHASSIS

ROOF PLAN
22x34 SCALE: 3/32"=1'-0"
11x17 SCALE: 3/64"=1'-0"

EQUIPMENT PLAN
22x34 SCALE: 1/2"=1'-0"
11x17 SCALE: 1/4"=1'-0"

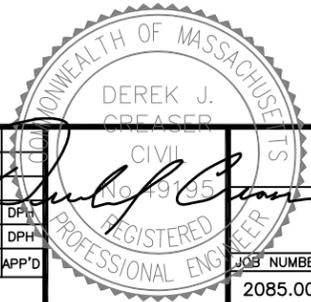


Hudson Design Group LLC
1600 OSGOOD STREET
BUILDING 20 NORTH, SUITE 3090
N. ANDOVER, MA 01845
TEL: (978) 557-5533
FAX: (978) 334-5586

SAI
27 NORTHWESTERN DR.
SALEM, NH 03079

SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
252 MEDFORD STREET
SOMERVILLE, MA 02143
MIDDLESEX COUNTY

at&t
550 COCHITUATE ROAD
FRAMINGHAM, MA 01701


				AT&T	
				ROOF AND EQUIPMENT PLAN (LTE-3C)	
NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH
SCALE: AS SHOWN			DESIGNED BY: AT	DRAWN BY: SG	
			JOB NUMBER	DRAWING NUMBER	REV
			2085.00	A-1	1

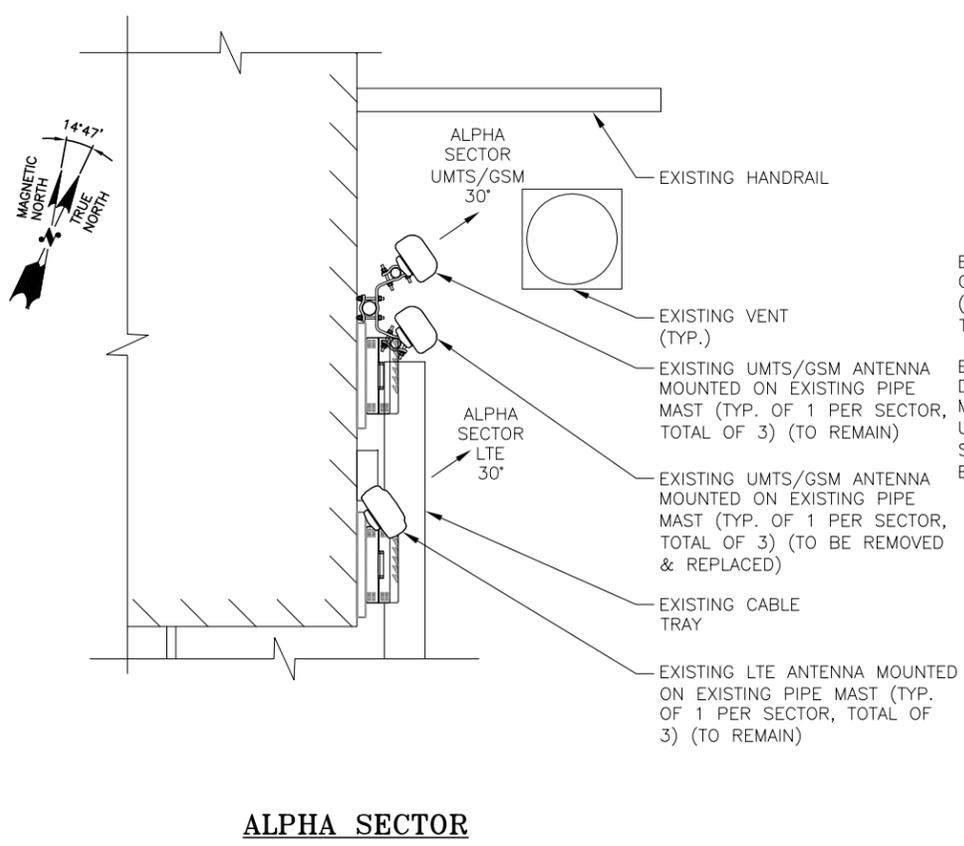

ALPHA SECTOR

EXISTING RRH MOUNTED ON EXISTING UNISTRUT (TYP. OF 2 PER SECTOR, TOTAL OF 6) (TO REMAIN)


EXISTING SURGE ARRESTOR DC2-48-60-0-9E MOUNTED TO EXISTING UNISTRUT (TYP. OF 1 PER SECTOR, TOTAL OF 3) (TO BE REMOVED & REPLACED)

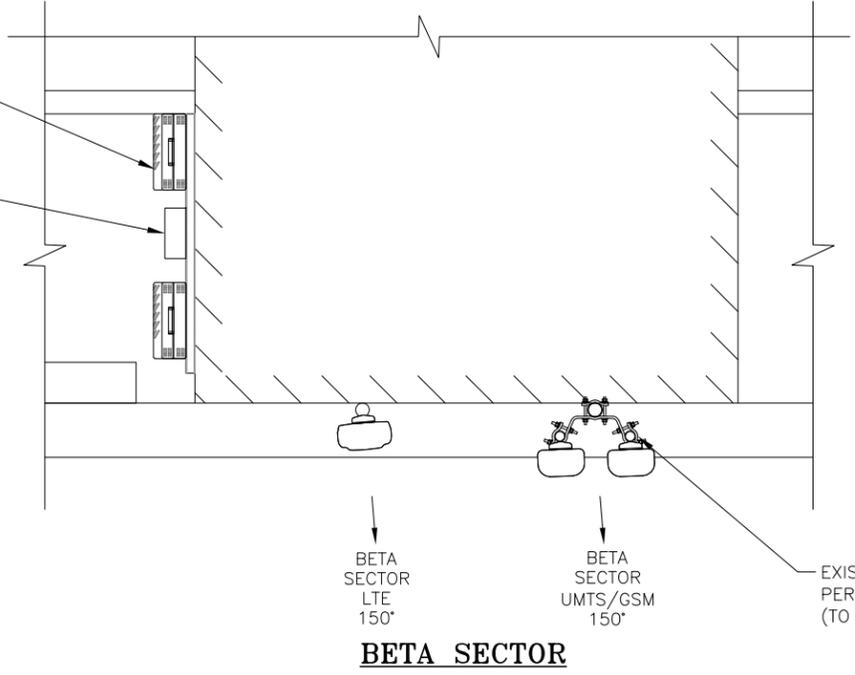

BETA SECTOR


NOTE:
REFER TO THE FINAL RF DATA SHEET FOR FINAL ANTENNA SETTINGS.

NOTE:
AN ANALYSIS FOR THE CAPACITY OF THE EXISTING STRUCTURES TO SUPPORT THE PROPOSED EQUIPMENT SHALL BE DETERMINED PRIOR TO CONSTRUCTION.

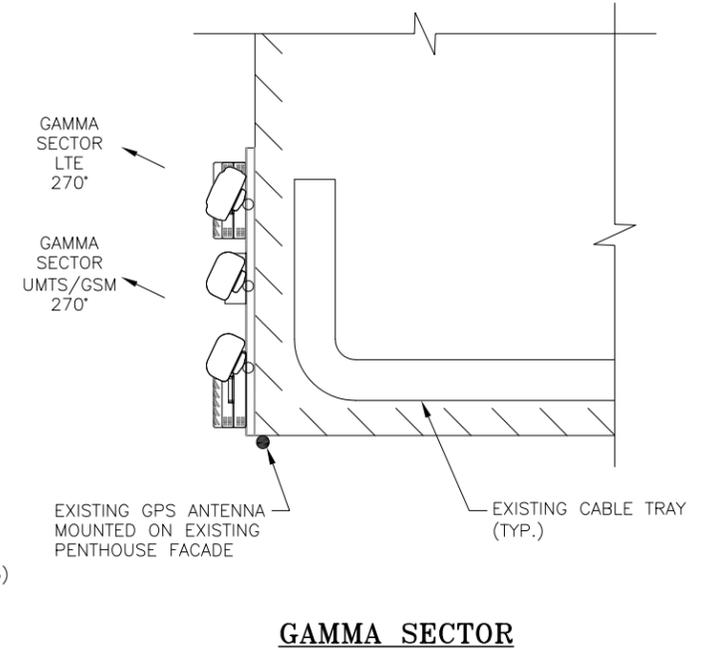

GAMMA SECTOR

EXISTING ANTENNA LAYOUT 1
SCALE: N.T.S.

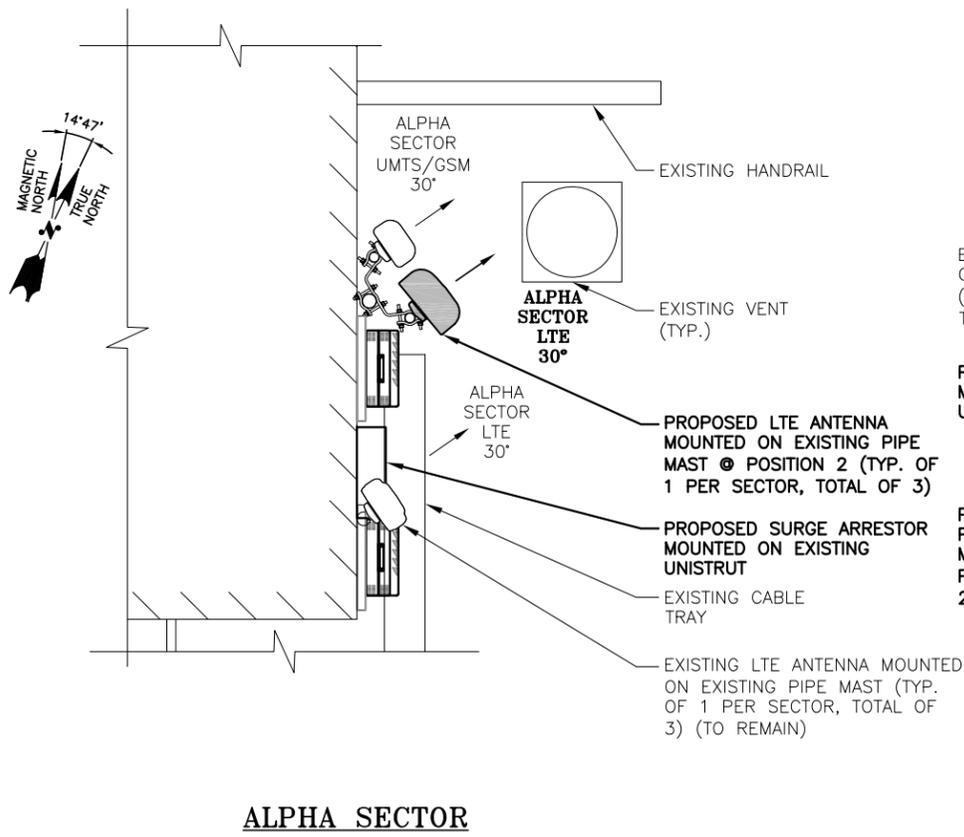


ALPHA SECTOR


EXISTING RRH MOUNTED ON EXISTING UNISTRUT (TYP. OF 2 PER SECTOR, TOTAL OF 6) (TO REMAIN)

PROPOSED SURGE ARRESTOR MOUNTED ON EXISTING UNISTRUT

PROPOSED RRH MOUNTED ON PROPOSED UNISTRUT MOUNTED ON EXISTING PENTHOUSE FACADE (TYP. OF 2 PER SECTOR, TOTAL OF 6)

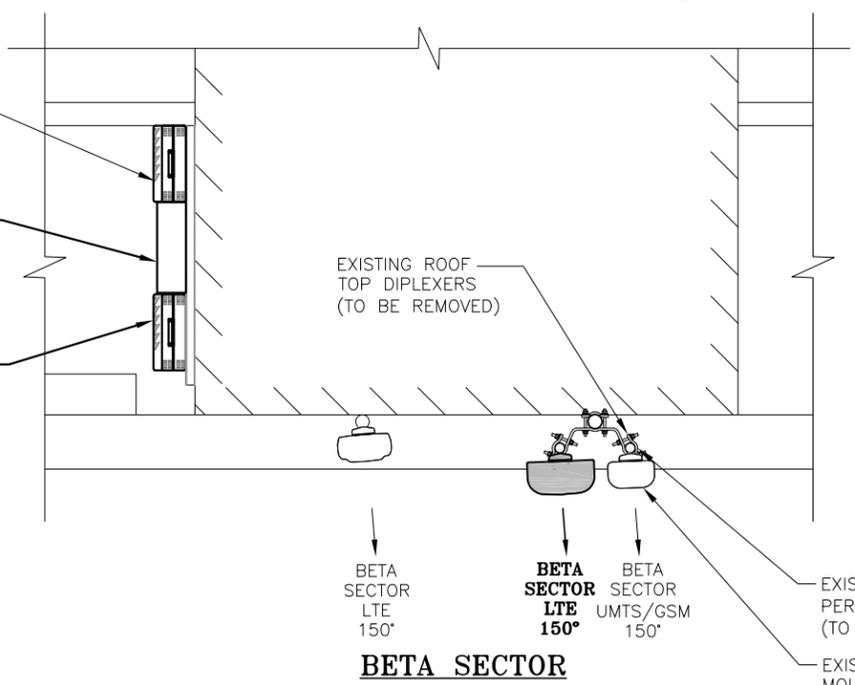

BETA SECTOR

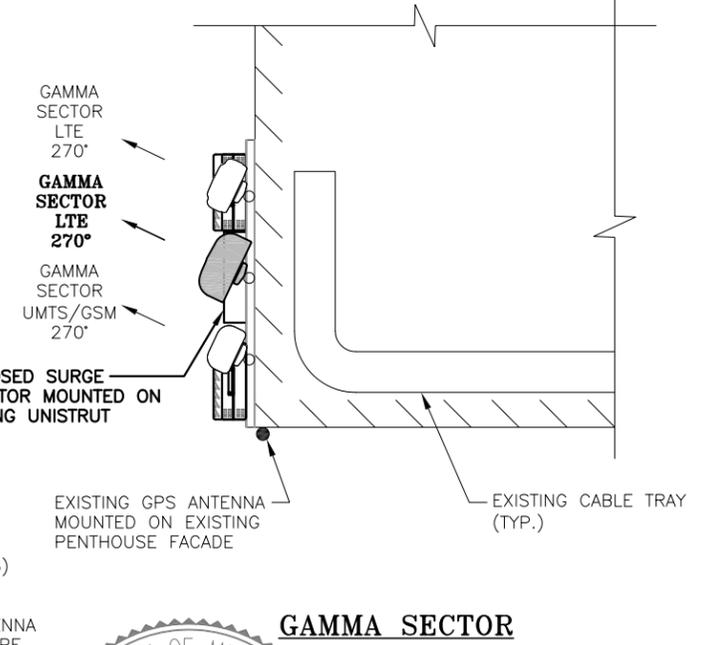

GAMMA SECTOR

EXISTING ANTENNA LAYOUT 2
SCALE: N.T.S.

Hudson Design Group LLC

1600 OSGOOD STREET
BUILDING 20 NORTH, SUITE 3090
N. ANDOVER, MA 01845

TEL: (978) 557-5553
FAX: (978) 336-5586

SAI

27 NORTHWESTERN DR.
SALEM, NH 03079

SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
252 MEDFORD STREET
SOMERVILLE, MA 02143
MIDDLESEX COUNTY

at&t

550 COCHITUATE ROAD
FRAMINGHAM, MA 01701

NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH

SCALE: AS SHOWN DESIGNED BY: AT DRAWN BY: SG

COMMONWEALTH OF MASSACHUSETTS

DEREK J. GREASER
CIVIL ENGINEER
No. 9195
REGISTERED PROFESSIONAL ENGINEER

AT&T

ANTENNA LAYOUTS
(LTE-3C)

JOB NUMBER: 2085.00 DRAWING NUMBER: A-2 REV: 1

NOTE:
REFER TO THE FINAL RF DATA SHEET FOR FINAL ANTENNA SETTINGS.

NOTE:
AN ANALYSIS FOR THE CAPACITY OF THE EXISTING STRUCTURES TO SUPPORT THE PROPOSED EQUIPMENT SHALL BE DETERMINED PRIOR TO CONSTRUCTION.

- TOP OF EXISTING PENTHOUSE
ELEV. 96'-0"± (AGL)
- CENTER OF PROPOSED GAMMA AT&T ANTENNA
ELEV. 93'-0"± (AGL)
- CENTER OF PROPOSED ALPHA AT&T ANTENNA
ELEV. 85'-0"± (AGL)
- CENTER OF PROPOSED BETA AT&T ANTENNA
ELEV. 82'-0"± (AGL)
- TOP OF EXISTING ROOF
ELEV. 78'-6"± (AGL)

EXISTING UMTS/GSM ANTENNA MOUNTED ON EXISTING PIPE MAST (TYP. OF 1 PER SECTOR, TOTAL OF 3) (TO REMAIN)

PROPOSED RRH MOUNTED ON PROPOSED UNISTRUT MOUNTED ON EXISTING PENTHOUSE FACADE (TYP. OF 2 PER SECTOR, TOTAL OF 6)

EXISTING RRH MOUNTED ON EXISTING UNISTRUT (TYP. OF 2 PER SECTOR, TOTAL OF 6) (TO REMAIN)

PROPOSED LTE ANTENNA MOUNTED ON EXISTING PIPE MAST @ POSITION 2 (TYP. OF 1 PER SECTOR, TOTAL OF 3)

EXISTING LTE ANTENNA MOUNTED ON EXISTING PIPE MAST (TYP. OF 1 PER SECTOR, TOTAL OF 3) (TO REMAIN)

EXISTING LTE ANTENNA MOUNTED ON EXISTING PIPE MAST (TYP. OF 1 PER SECTOR, TOTAL OF 3) (TO REMAIN)

PROPOSED SURGE ARRESTOR MOUNTED ON EXISTING UNISTRUT (TYP. OF 1 PER SECTOR, TOTAL OF 3)

EXISTING 3" FLEX CONDUIT FOR POWER & FIBER)

PROPOSED (2) DC POWER & (1) FIBER (TO REPLACE EXISTING 9E/10E CONFIGURATION)

● GROUND LEVEL
ELEV. 0'-0"± (AGL)

EXISTING AT&T ROOM IN BASEMENT

SOUTH ELEVATION

22x34 SCALE: 1/8"=1'-0"
11x17 SCALE: 1/16"=1'-0"

1
A-3

0 4'-0" 8'-0" 16'-0" 24'-0"



Hudson Design Group LLC
1600 OSGOOD STREET
BUILDING 20 NORTH, SUITE 3090
N. ANDOVER, MA 01845
TEL: (978) 557-5553
FAX: (978) 334-5586

SAI
27 NORTHWESTERN DR.
SALEM, NH 03079


SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
252 MEDFORD STREET
SOMERVILLE, MA 02143
MIDDLESEX COUNTY

at&t
550 COCHITUATE ROAD
FRAMINGHAM, MA 01701

NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH

SCALE: AS SHOWN DESIGNED BY: AT DRAWN BY: SG


AT&T	
ELEVATION (LTE-3C)	
JOB NUMBER 2085.00	DRAWING NUMBER A-3
REV	1

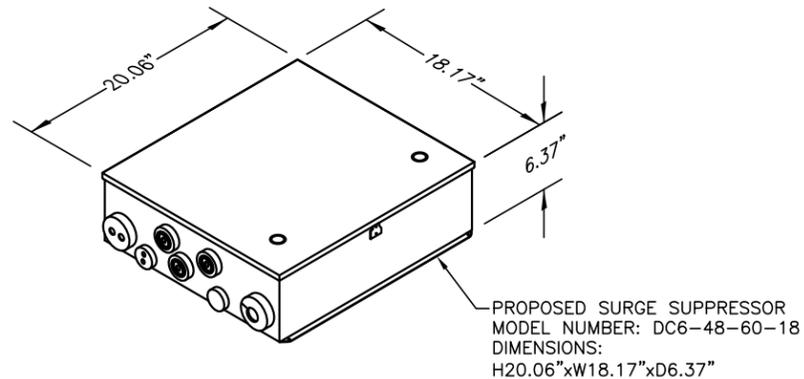


NOTE:
MOUNT PER MANUFACTURER'S SPECIFICATIONS.

EXISTING ANTENNA SCHEDULE				PROPOSED ANTENNA SCHEDULE			
SECTOR	MAKE	MODEL#	SIZE (INCHES)	SECTOR	MAKE	MODEL#	SIZE (INCHES)
ALPHA:	KATHREIN	742-264	51.8X10.3X5.5	ALPHA:	KATHREIN	742-264	51.8X10.3X5.5
	KATHREIN	742-264	51.8X10.3X5.5		CCI	OPA-65R-LCUU	48X14.4X7.3
	KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9		KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9
BETA:	KATHREIN	742-264	51.8X10.3X5.5	BETA:	KATHREIN	742-264	51.8X10.3X5.5
	KATHREIN	742-264	51.8X10.3X5.5		CCI	OPA-65R-LCUU	48X14.4X7.3
	KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9		KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9
GAMMA:	KATHREIN	742-264	51.8X10.3X5.5	GAMMA:	KATHREIN	742-264	51.8X10.3X5.5
	KATHREIN	742-264	51.8X10.3X5.5		CCI	OPA-65R-LCUU	48X14.4X7.3
	KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9		KMW	AM-X-CD-14-65-OOT-RET	48X11.8X5.9


PROPOSED SURGE ARRESTOR DETAIL 5
SCALE: N.T.S. A-4

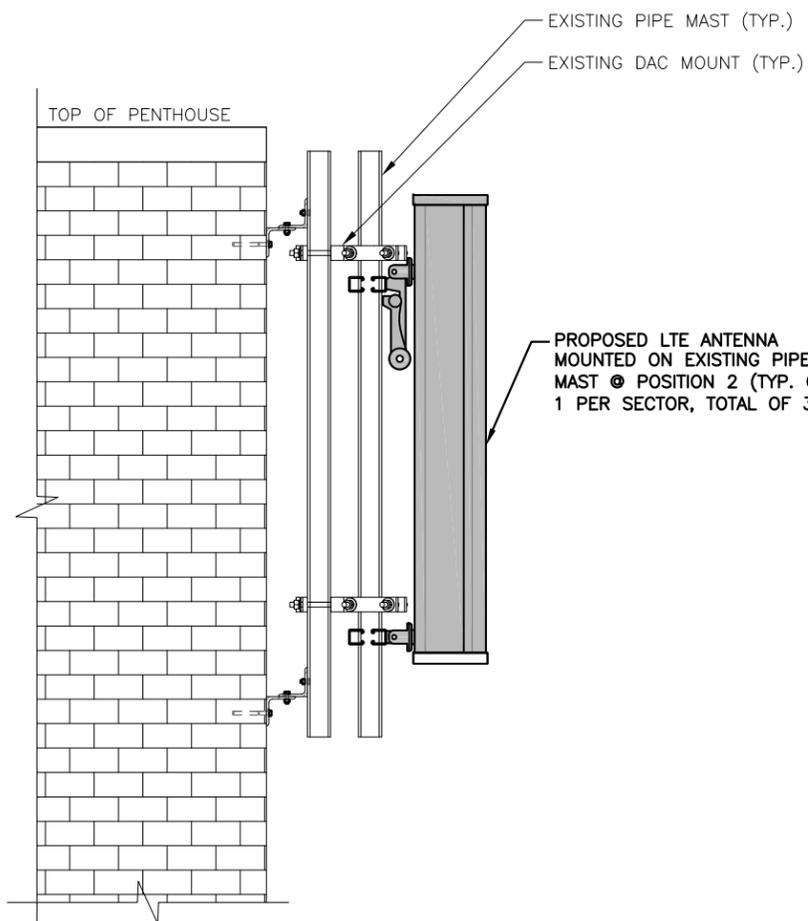

**PROPOSED ALPHA & GAMMA
LTE ANTENNA MOUNTING DETAIL** 1
SCALE: N.T.S. A-4

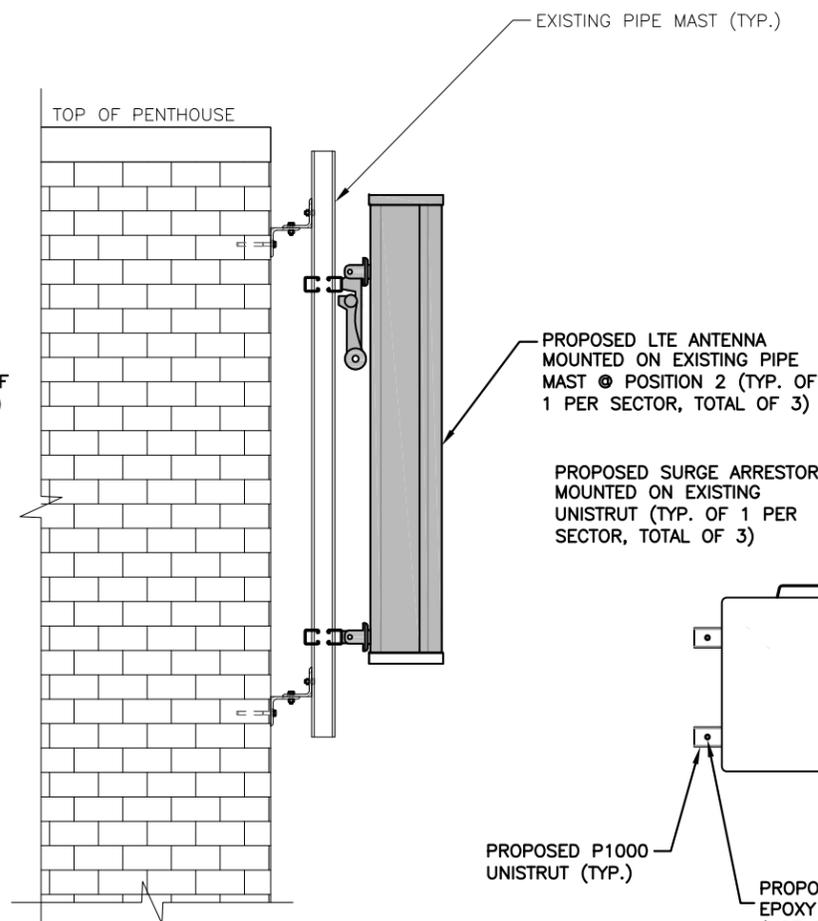


**PROPOSED BETA
LTE ANTENNA MOUNTING DETAIL** 2
SCALE: N.T.S. A-4

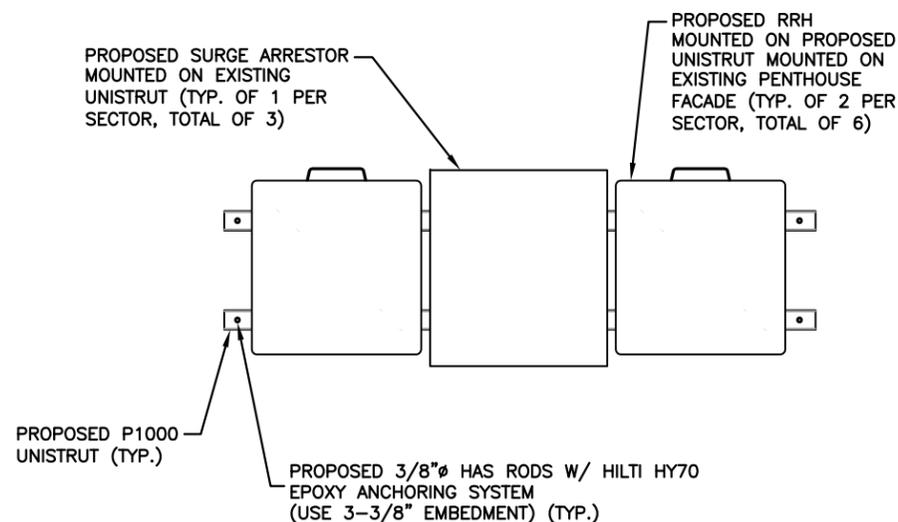

**PROPOSED SURGE ARRESTOR
& RRH MOUNTING DETAIL** 3
SCALE: N.T.S. A-4

NOTE:
REFER TO THE FINAL RF DATA SHEET FOR FINAL ANTENNA SETTINGS.

NOTE:
AN ANALYSIS FOR THE CAPACITY OF THE EXISTING STRUCTURES TO SUPPORT THE PROPOSED EQUIPMENT SHALL BE DETERMINED PRIOR TO CONSTRUCTION.

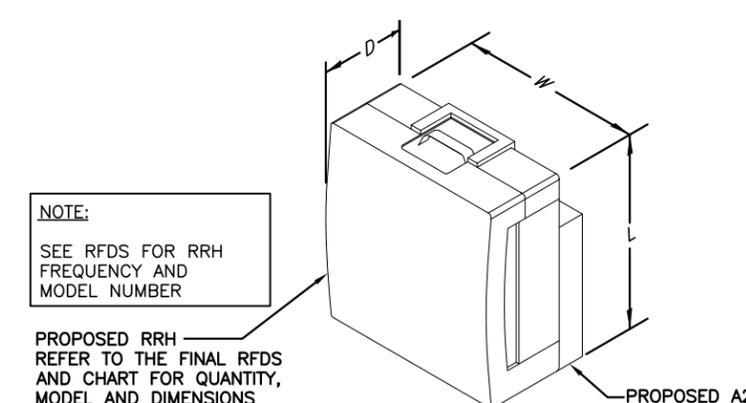

	L	W	D
RRUS - 11	19.7"	17.0"	7.2"
RRUS - 12	20.4"	18.5"	7.5"
RRUS - 32	26.7"	12.1"	6.7"
RRUS - E2	20"	20.4"	9.5"
LTE - A2	16.4"	15.2"	3.4"

NOTE:
MOUNT PER MANUFACTURER'S SPECIFICATIONS.

PROPOSED RRH DETAIL 4
SCALE: N.T.S. A-4

Hudson Design Group
1600 OSGOOD STREET
BUILDING 20 NORTH, SUITE 3090
N. ANDOVER, MA 01845
TEL: (978) 557-5553
FAX: (978) 334-5586

SAI
27 NORTHWESTERN DR.
SALEM, NH 03079

SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
252 MEDFORD STREET
SOMERVILLE, MA 02143
MIDDLESEX COUNTY

at&t
550 COCHITUATE ROAD
FRAMINGHAM, MA 01701


AT&T
DETAILS
(LTE-3C)

NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH

SCALE: AS SHOWN DESIGNED BY: AT DRAWN BY: SG

JOB NUMBER: 2085.00 DRAWING NUMBER: A-4 REV: 1


DEREK J. GREASER
REGISTERED PROFESSIONAL ENGINEER

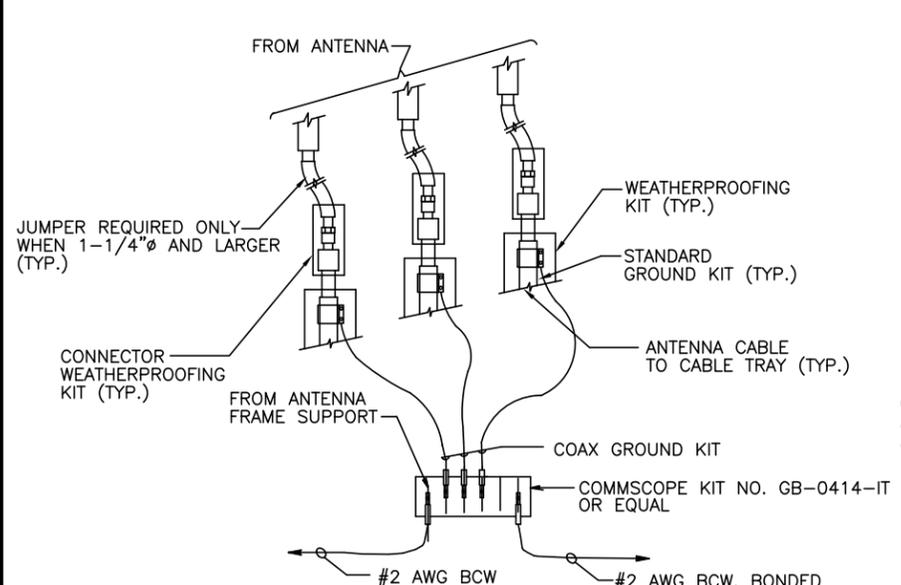

NOTE:
1. DO NOT INSTALL CABLE GROUND KIT AT A BEND AND ALWAYS DIRECT GROUND WIRE DOWN TO CIGBE.


GROUND WIRE TO GROUND BAR CONNECTION DETAIL

1
N.T.S.

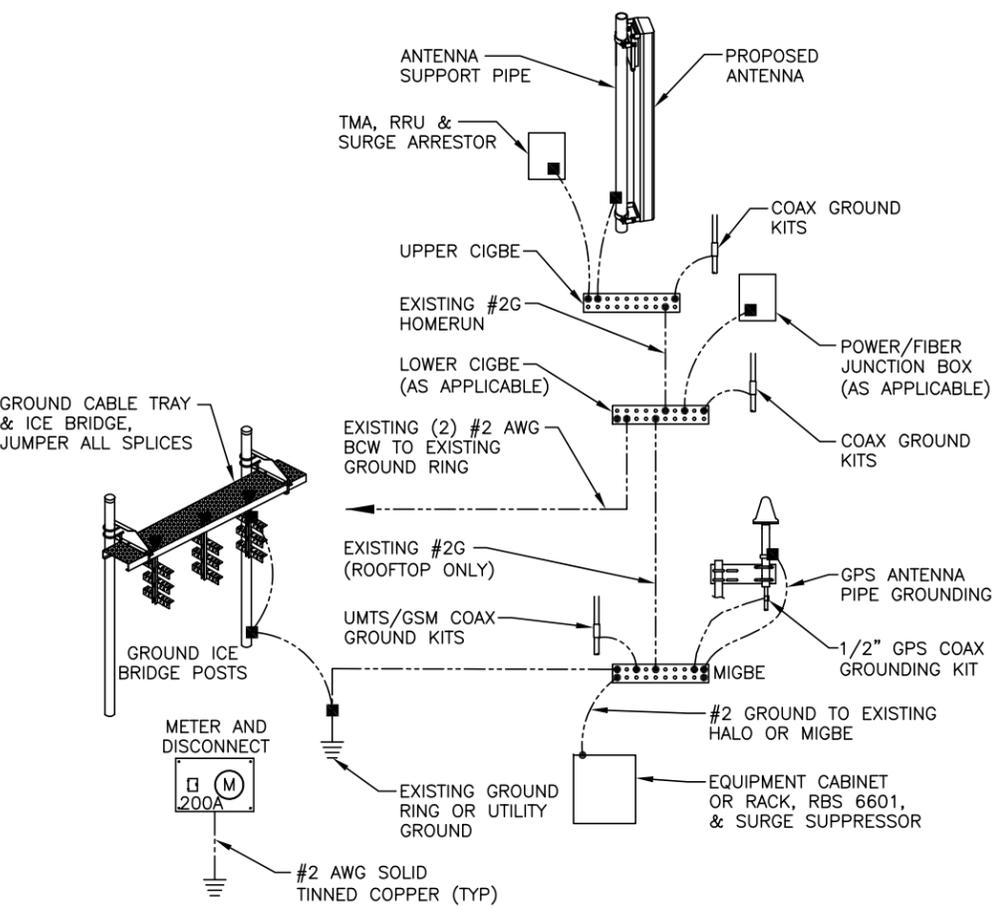



GROUNDING RISER DIAGRAM

2
N.T.S.

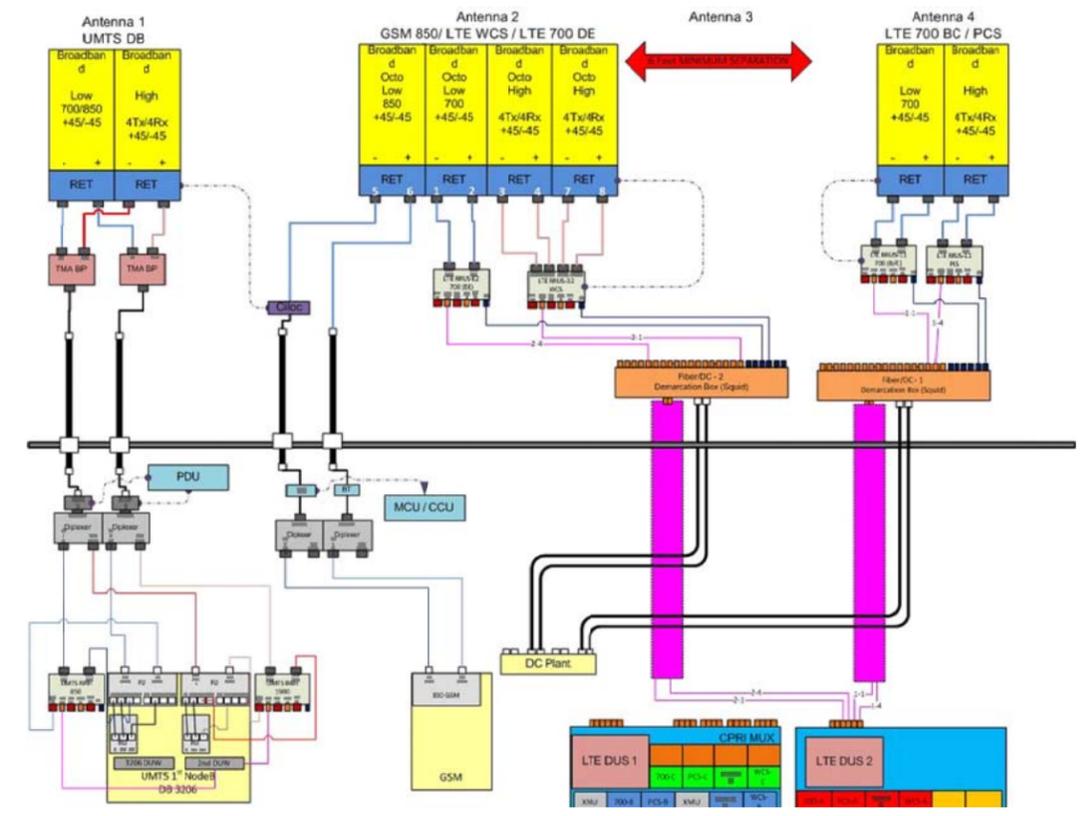

PLUMBING DIAGRAM

3
N.T.S.

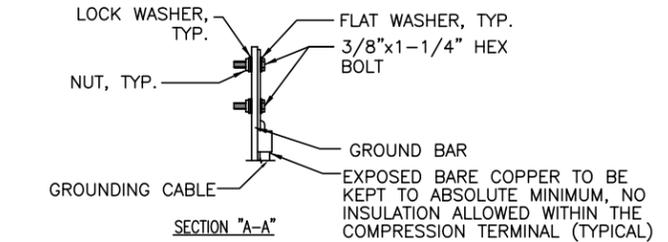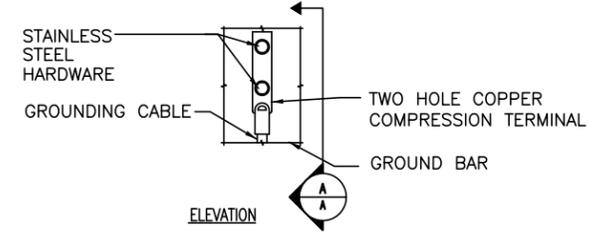


NOTE:
1. "DOUBLING UP" OR "STACKING" OF CONNECTION IS NOT PERMITTED.
2. OXIDE INHIBITING COMPOUND TO BE USED AT ALL LOCATIONS.
3. CADWELD DOWNLEADS FROM UPPER EGB, LOWER EGB, AND MGB.

TYPICAL GROUND BAR CONNECTION DETAIL

4
N.T.S.

WIRELESS SOLUTIONS INC.				
NO.	REQ.	PART NO.	DESCRIPTION	
①	1	HLGB-0420-IS	SOLID GND. BAR (20"x4"x1/4")	
②	2		WALL MTG. BRKT.	
③	2		INSULATORS	
④	4		5/8"-11x1" H.H.C.S.	
⑤	4		5/8 LOCKWASHER	

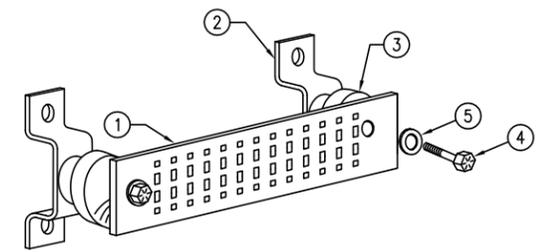

GROUND BAR - DETAIL

5
N.T.S.

EACH GROUND CONDUCTOR TERMINATING ON ANY GROUND BAR SHALL HAVE AN IDENTIFICATION TAG ATTACHED AT EACH END THAT WILL IDENTIFY ITS ORIGIN AND DESTINATION.

SECTION "P" - SURGE PRODUCERS

- CABLE ENTRY PORTS (HATCH PLATES) (#2)
- GENERATOR FRAMEWORK (IF AVAILABLE) (#2)
- TELCO GROUND BAR
- COMMERCIAL POWER COMMON NEUTRAL/GROUND BOND (#2)
- +24V POWER SUPPLY RETURN BAR (#2)
- 48V POWER SUPPLY RETURN BAR (#2)
- RECTIFIER FRAMES.

SECTION "A" - SURGE ABSORBERS

- INTERIOR GROUND RING (#2)
- EXTERNAL EARTH GROUND FIELD (BURIED GROUND RING) (#2)
- METALLIC COLD WATER PIPE (IF AVAILABLE) (#2)
- BUILDING STEEL (IF AVAILABLE) (#2)

Hudson Design Group LLC

1600 OSGOOD STREET
BUILDING 20 NORTH, SUITE 3090
N. ANDOVER, MA 01845

TEL: (978) 557-5553
FAX: (978) 334-5586

SAI

27 NORTHWESTERN DR.
SALEM, NH 03079

SITE NUMBER: MA2085
SITE NAME: SOMERVILLE
MEDFORD STREET
252 MEDFORD STREET
SOMERVILLE, MA 02143
MIDDLESEX COUNTY

at&t

550 COCHITUATE ROAD
FRAMINGHAM, MA 01701

AT&T

PLUMBING DIAGRAM & GROUNDING DETAILS (LTE-3C)

NO.	DATE	REVISIONS	BY	CHK	APP'D
1	09/16/15	ISSUED FOR CONSTRUCTION	EB	AT	DPH
A	08/26/15	ISSUED FOR REVIEW	SG	AT	DPH

SCALE: AS SHOWN DESIGNED BY: AT DRAWN BY: SG

JOB NUMBER: 2085.00 DRAWING NUMBER: G-1 REV: 1

